
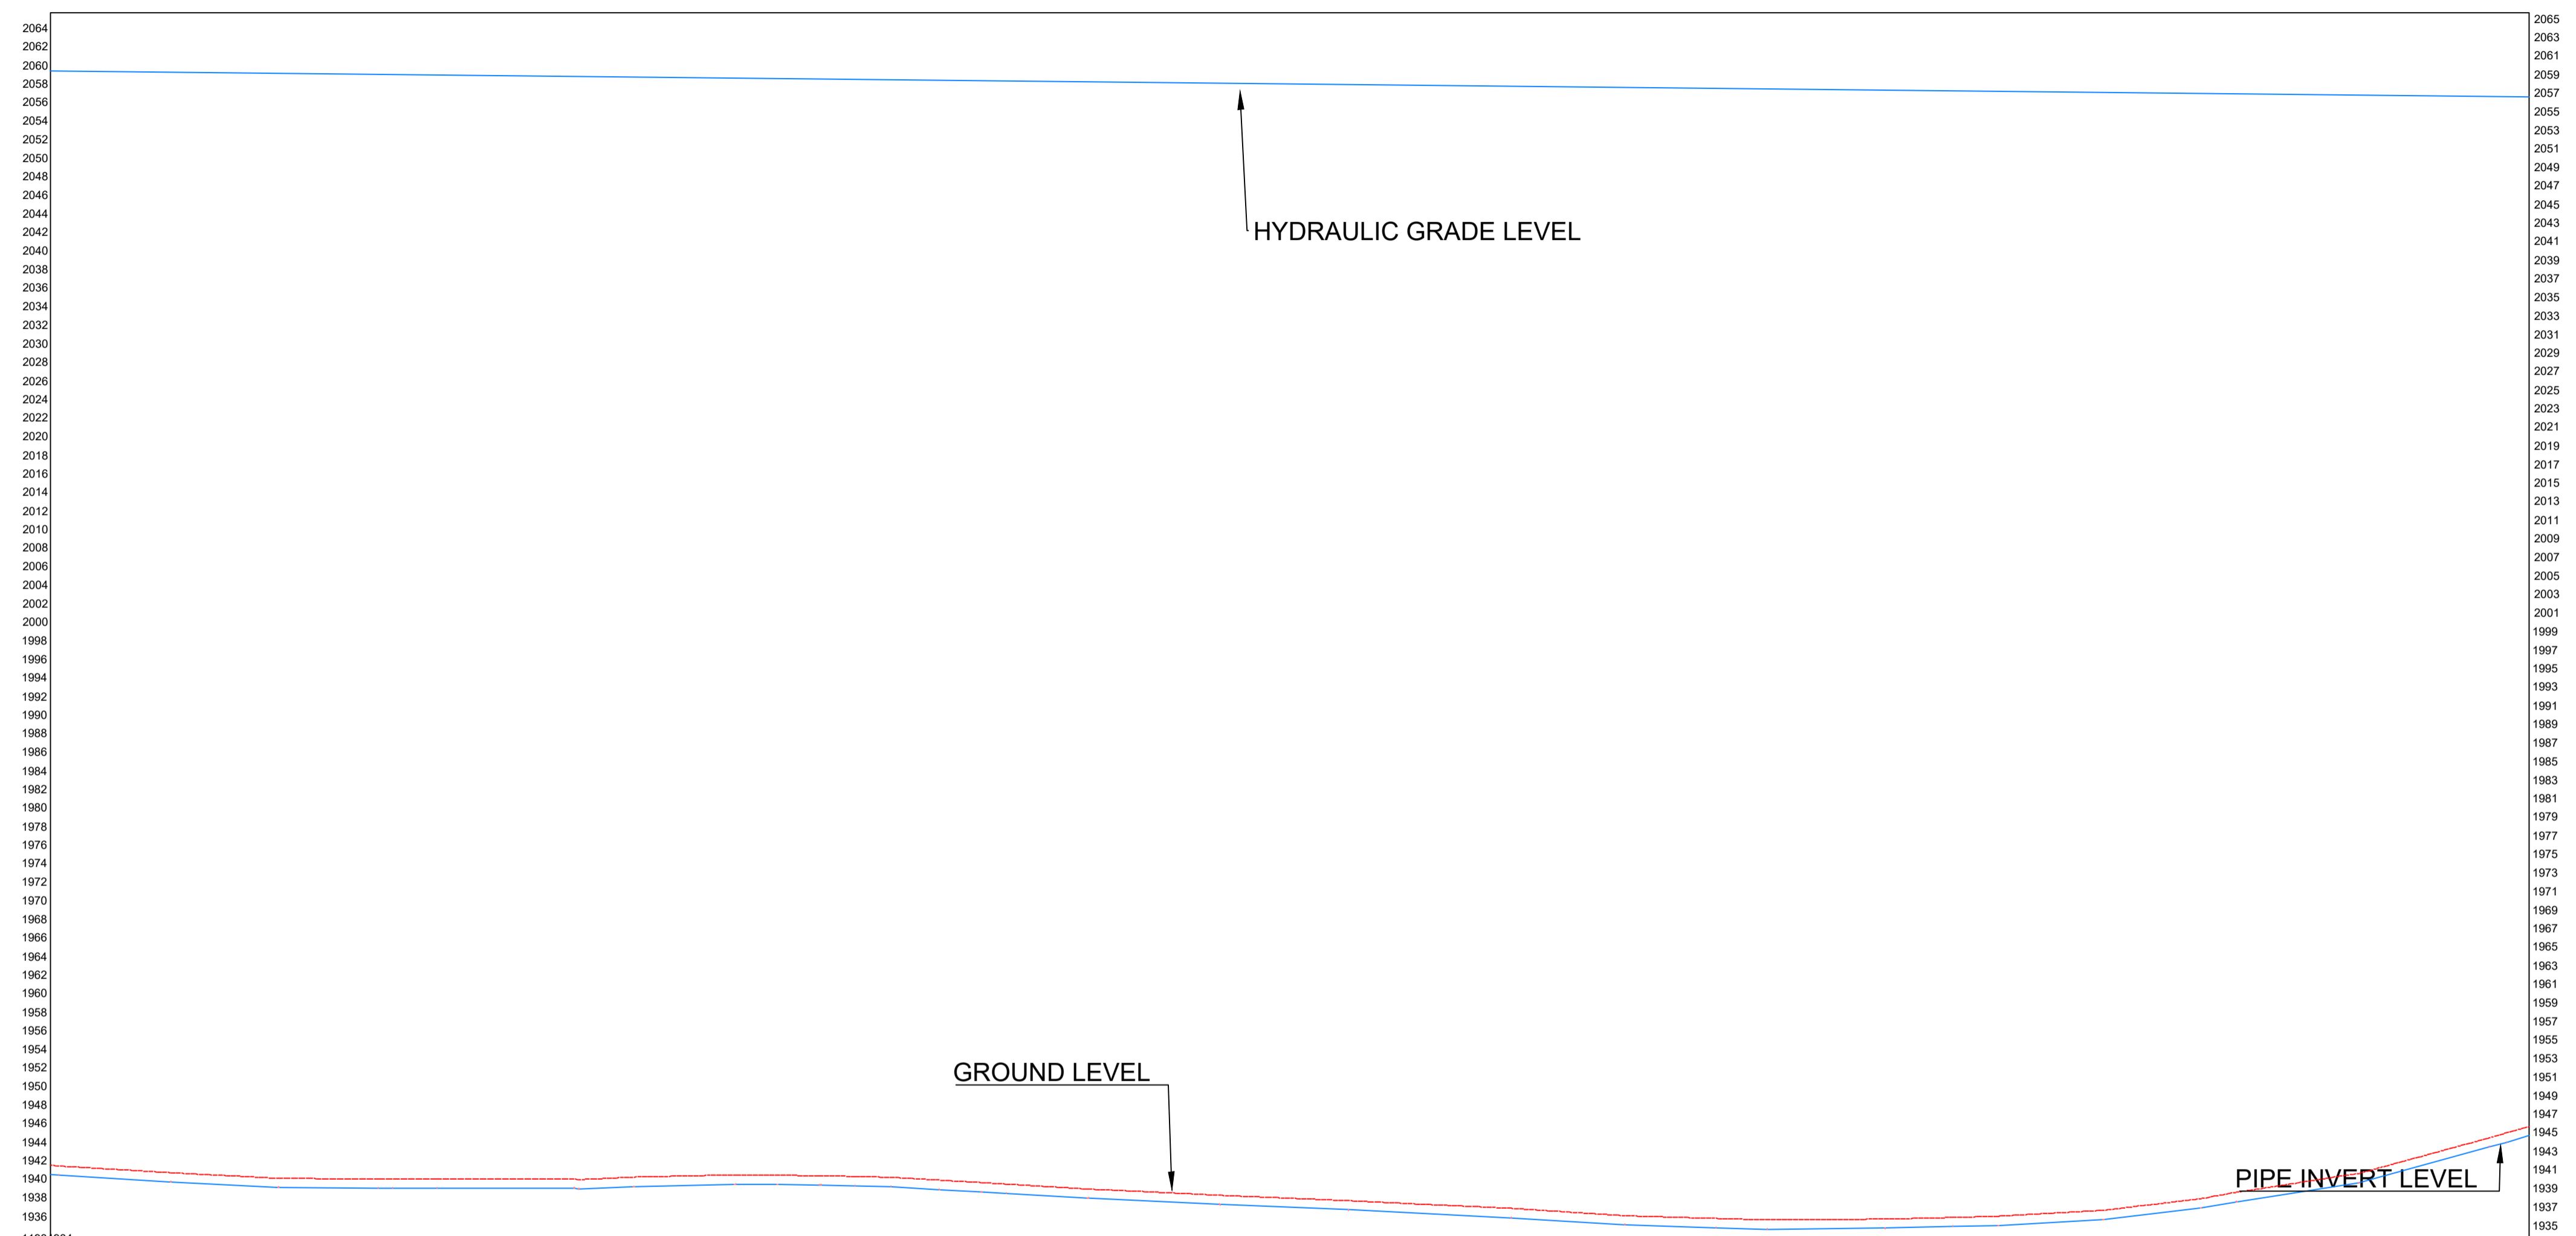


LINE 1 PROFILE

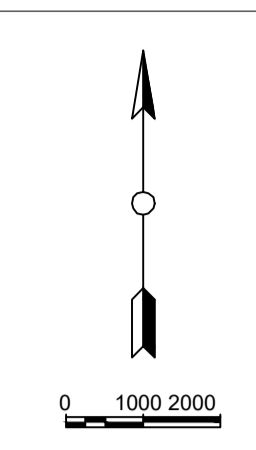

CHAINAGE	0+534	0+600	0+700	0+800	0+900	1+000	1+068
ORIGINAL GROUND LEVEL	1941.45	1940.00	1940.33	1937.94	1935.65	1938.12	1944.66
PIPE INVERT LEVEL	1940.45	1939.00	1939.33	1936.94	1934.65	1937.12	1943.51
HYDRAULIC GRADE LEVEL	2059.34	2059.02	2058.49	2057.95	2057.42	2056.89	2056.57
FLOW PARAMETERS	0.0217M ³ /S						
PIPE INFO	160MM PN 12.5 PIPE		160MM PN 12.5 PIPE			160MM PN 12.5 PIPE	
SURVEY REMARKS							

- NOTES
- ALL DIMENSIONS ARE IN METERS UNLESS STATED OTHERWISE
 - ALL SCALE GIVEN ARE FOR A1 PAPER SIZE
 - COORDINATES ARE BASED ON UTM.
 - LOCATION OF AIR VALVES, WASHOUTS, BENDS AND OTHER FITTINGS WILL BE AS DIRECTED BY THE ENGINEER ON SITE.
 - GROUND AND INVERT LEVEL SHOWN ARE AS SHOWN ON DRAWING UNLESS OTHERWISE INDICATED ON SITE BY THE ENGINEER.
 - PIPES ARE TO BE LAID TO EVEN GRADIENTS WITH A MINIMUM COVER OF 1.0M. WHERE COVER IS LESS THAN THIS, PIPE TO BE SURROUNDED WITH CONCRETE.
 - ALL BENDS ARE HORIZONTAL UNLESS OTHERWISE STATED.
 - IN WATER LOGGED AREAS, PIPES TO BE BEDDED WITH SINGLE SIZED OR GRADED AGGREGATES AND/OR ANCHOR BLOCKS AS MAY BE DIRECTED ON SITE BY THE ENGINEER.

No.	Revision/Issue	Date
-----	----------------	------

CLIENT

MATHIRA WATER & SANITATION COMPANY LTD
 P.O BOX 1981 - 10101
 KARATINA NYERI

PROJECT NAME :
 IMPROVEMENT OF WATER SUPPLY TO
 KIRIMUKUYU WARD MATHIRA WEST SUB - COUNTY

KIAMUCHERU_MUBERETHI GRAVITY MAINLINE	SHEET
Date: OCTOBER_2023	2
Scale: As Notified	